eDATA

Provided by pjm

Elevated Significant Risk

Tuesday June 14, 2005 - 11:15 EDT

Current PJM RTO Load: 116,456MW

GENSCAPE
www.genscape.com

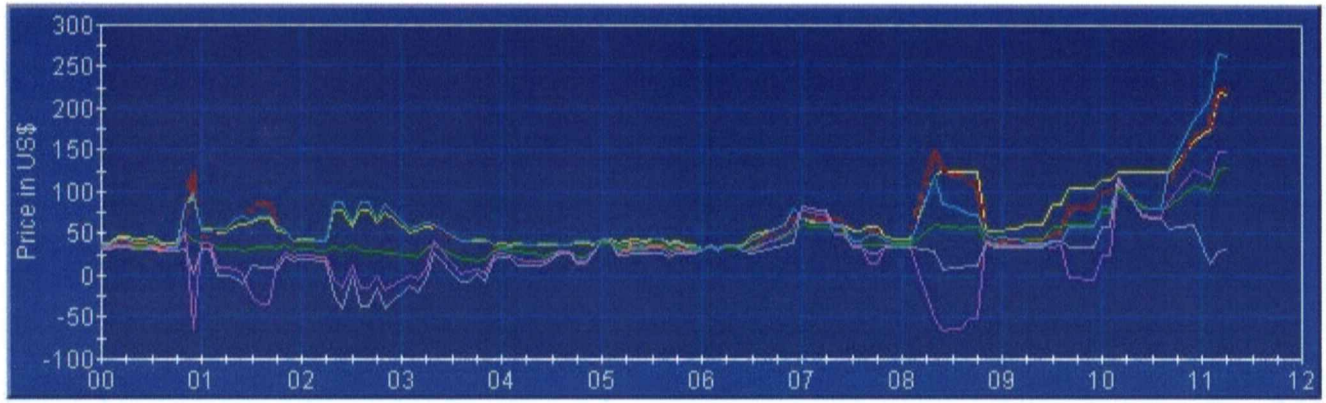

RT
DA
BOTH

Scale
12 hr

LMPs

Time
< . >
06/14/2005

LMP	Cur	Avg	Min	Max
APS (Zone)	128.1	42.31	17.87	128.1
BEDINGTON (500/765KV Agg)	223.1	61.34	29.63	224.5
DOUBS (500/765KV Agg)	263.8	59.25	29.08	266.1

LMP	Cur	Avg	Min	Max
GRANDPT--138 KV--T62	217.2	64.76	28.96	218.4
BLACKOAK (500/765KV Agg)	148.4	26.10	-66.7	148.4
PRUNTYTOWN (500/765KV Agg)	31.58	25.64	-38.2	117.1

Select: LMP Chart

My eData Preferences

Chambersburg | CburgFTR
Berlin | St Michaels
ECI | All
New Jersey | Seaford

My eData | **Constraints**
Energy Contracts | Activity Log
eSuite | Announcements
IRC Report | **Emergency Msgs**

Forecast Last Updated - Tuesday June 14, 2005 - 11:15 EDT

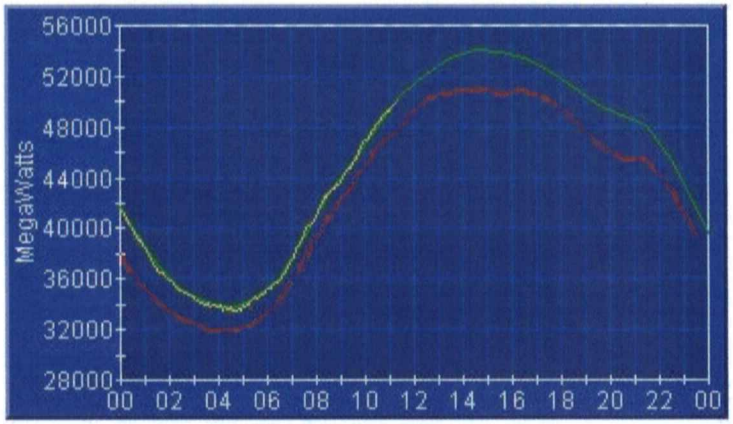

06/13/2005 | 06/14/2005 | 06/15/2005 | Western Regio

Select: PJM Loads

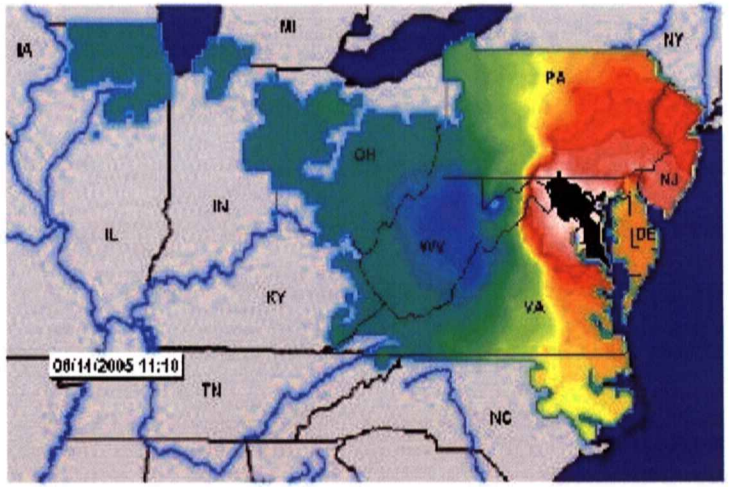

Legend | PJM RTO

Select: PJM LMP Contour Map

PJM LMP Graph
June 14, 2005 - 11:15 EDT

eDATA

Provided by pjm

Elevated — Significant Risk

Tuesday June 14, 2005 - 13:05 EDT

Current PJM RTO Load: 122,149MW

www.ces-ltd.com

CUSTOMIZED ENERGY SOLUTIONS

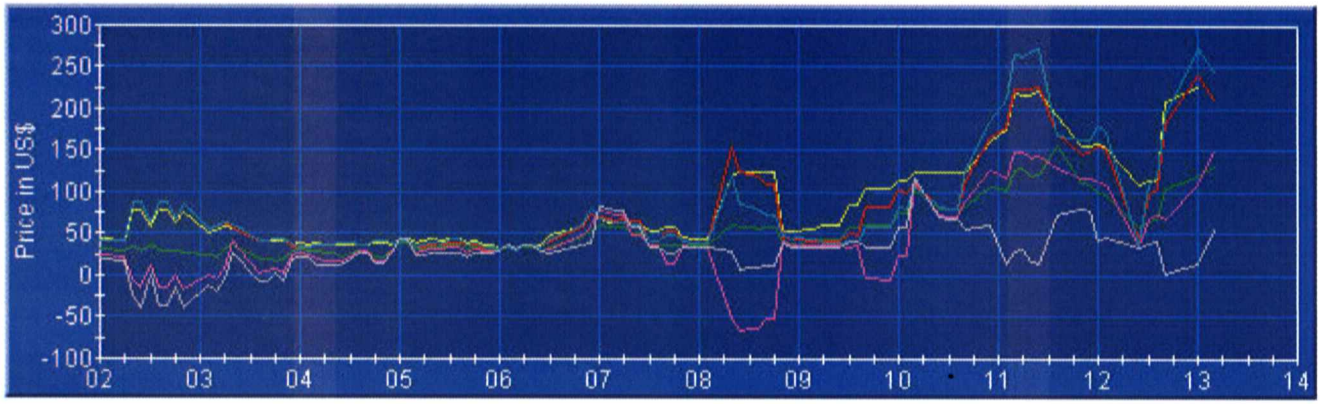

RT
DA
BOTH

Scale: 12 hr

LMPs

Time

06/14/2005

LMP	Cur	Avg	Min	Max
APS (Zone)	131.8	51.35	17.87	155.4
BEDINGTON (500/765KV Agg)	212.6	74.44	29.63	241.1
DOUBS (500/765KV Agg)	246.8	74.92	29.08	273.3

LMP	Cur	Avg	Min	Max
GRANDPT--138 KV--T62	227.0	78.74	28.96	227.0
BLACKOAK (500/765KV Agg)	148.6	37.43	-66.7	148.6
PRUNTYTOWN (500/765KV Agg)	56.32	28.82	-38.2	117.1

Select: LMP Chart

My eData Preferences

Chambersburg | CburgFTR
Berlin | St Michaels
ECI | All
New Jersey | Seaford

My eData | Constraints
Energy Contracts | Activity Log
eSuite | Announcements
IRC Report | Emergency Msgs

Forecast Last Updated - Tuesday June 14, 2005 - 12:45 EDT

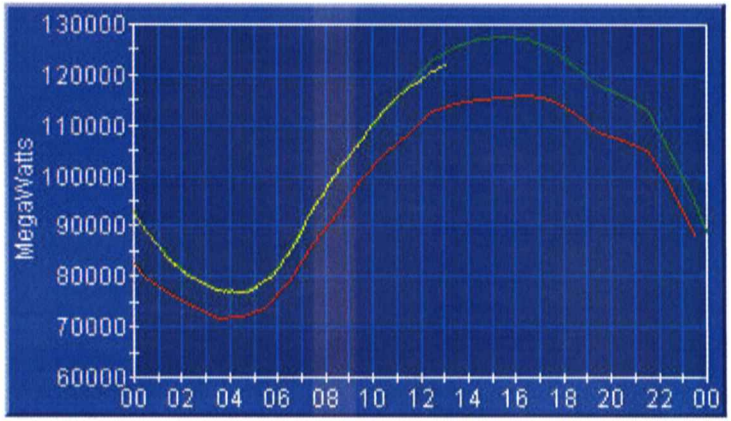

06/13/2005 | 06/14/2005 | 06/15/2005 | PJM RTO Tota

Select: PJM Loads

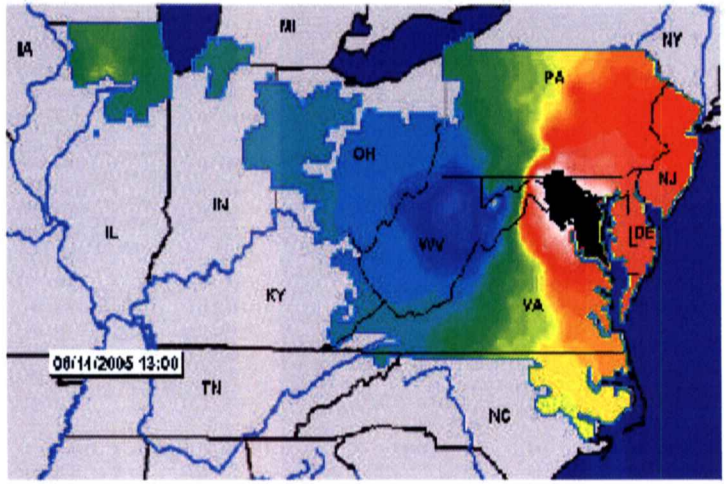

Legend | PJM RTO

Select: PJM LMP Contour Map

PJM LMP Graph
June 14, 2005 13:05 EDT

eDATA

Provided by pjm

Elevated Significant Risk

Tuesday June 14, 2005 - 14:45 EDT

Current PJM RTO Load: 124,256MW

The nation's first and only real-time power output data service

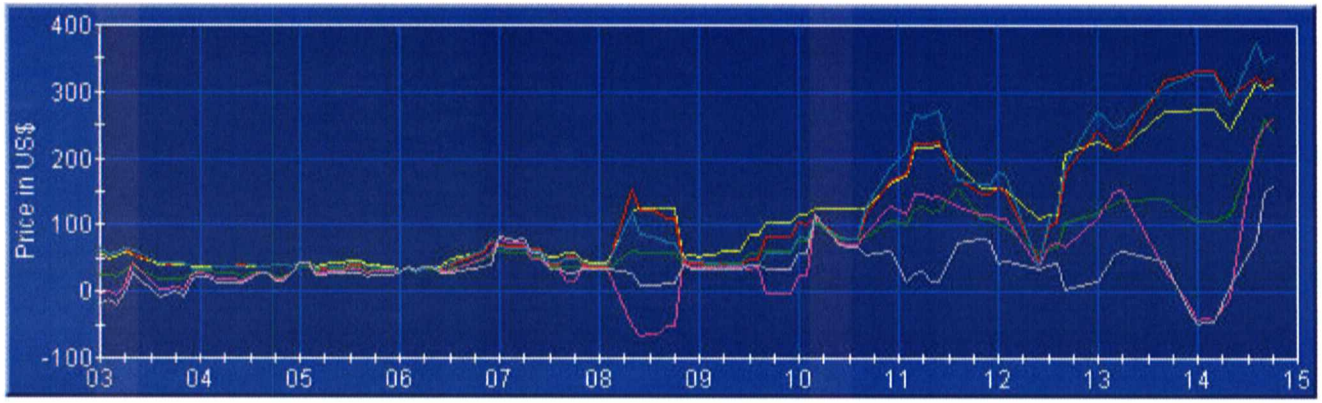

RT
DA
BOTH

Scale
12 hr

LMPs

Time
< . >
06/14/2005

LMP	Cur	Avg	Min	Max
APS (Zone)	240.4	62.79	17.87	259.5
BEDINGTON (500/765KV Agg)	320.4	96.78	29.63	334.0
DOUBS (500/765KV Agg)	354.3	98.24	29.08	376.1

LMP	Cur	Avg	Min	Max
GRANDPT--138 KV--T62	310.8	99.60	28.96	313.8
BLACKOAK (500/765KV Agg)	259.9	44.48	-66.7	259.9
PRUNTYTOWN (500/765KV Agg)	159.7	33.11	-46.7	159.7

Select: LMP Chart

My eData Preferences

Chambersburg | CburgFTR
Berlin | St Michaels
ECI | All
New Jersey | Seaford

My eData | Constraints
Energy Contracts | Activity Log
eSuite | Announcements
IRC Report | **Emergency Msgs**

Forecast Last Updated - Tuesday June 14, 2005 - 14:45 EDT

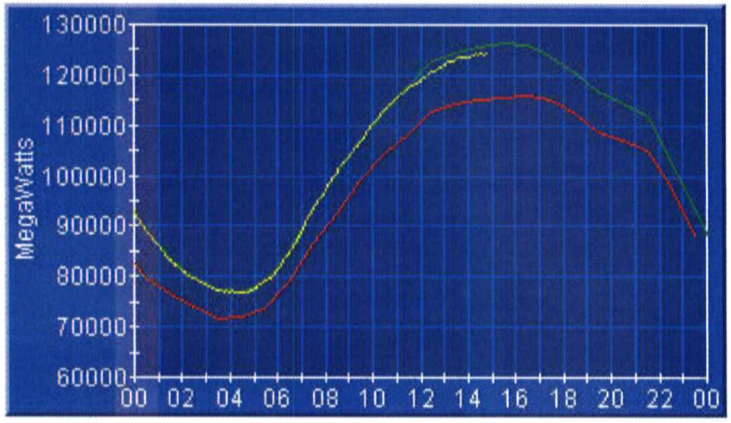

06/13/2005 | 06/14/2005 | 06/15/2005 | PJM RTO Tota

Select: PJM Loads

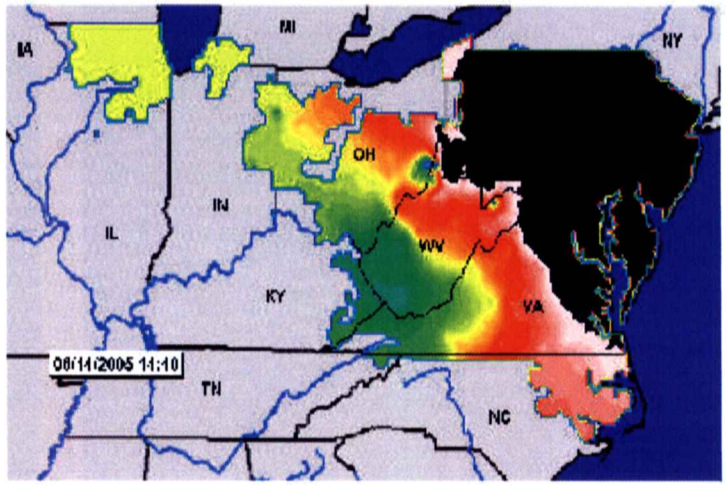

Legend | PJM RTO

Select: PJM LMP Contour Map

PJM LMP Graph
June 14, 2005 14:45 EDT

eDATA

Provided by pjm

Elevated Significant Risk

Tuesday June 14, 2005 - 16:20 EDT

Current PJM RTO Load: 125,015MW

The nation's first and only real-time power output data service

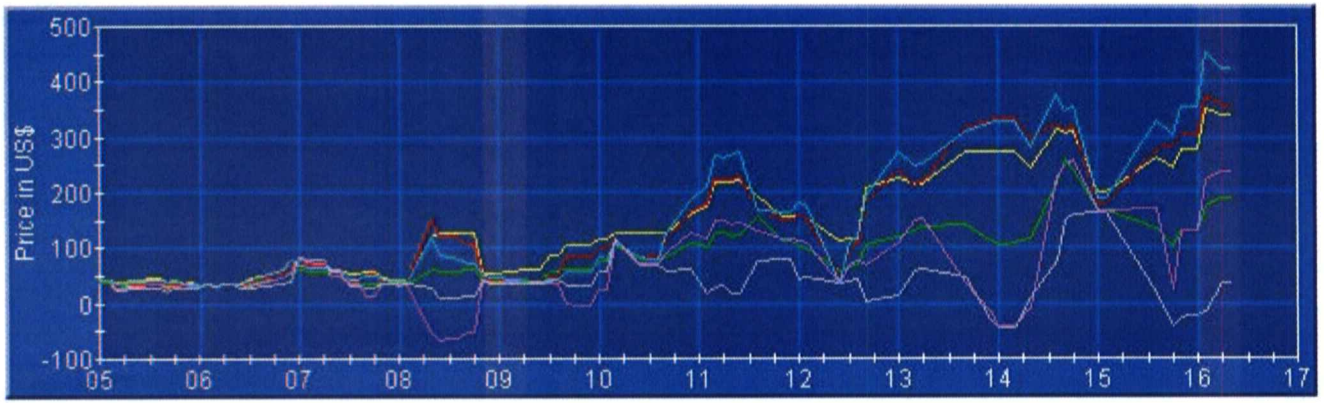

RT
DA
BOTH

Scale: 12 hr

LMPs

Time

< . >

06/14/2005

LMP	Cur	Avg	Min	Max
APS (Zone)	188.4	79.45	29.16	259.5
BEDINGTON (500/765KV Agg)	356.8	128.0	29.63	370.1
DOUBS (500/765KV Agg)	423.9	134.1	29.08	451.1

LMP	Cur	Avg	Min	Max
GRANDPT--138 KV--T62	339.0	129.8	28.96	350.6
BLACKOAK (500/765KV Agg)	235.1	62.17	-66.7	259.9
PRUNTYTOWN (500/765KV Agg)	36.09	37.49	-46.7	165.1

Select: LMP Chart

My eData Preferences

Chambersburg | CburgFTR
Berlin | St Michaels
ECI | All
New Jersey | Seaford

Forecast Last Updated - Tuesday June 14, 2005 - 16:15 EDT

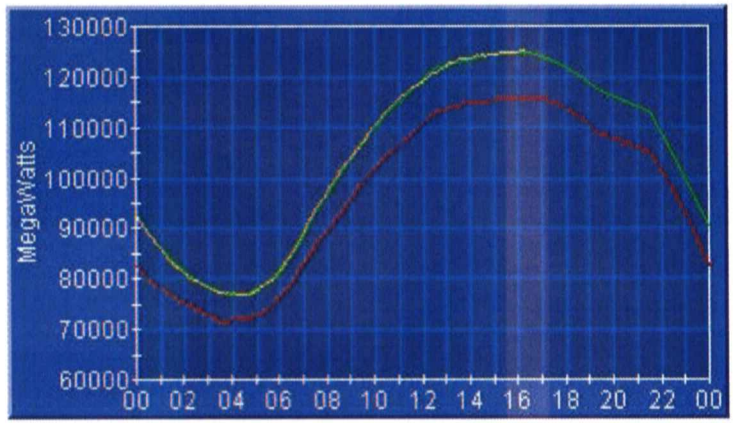

06/13/2005 | 06/14/2005 | 06/15/2005 | PJM RTO Tota

Select: PJM Loads

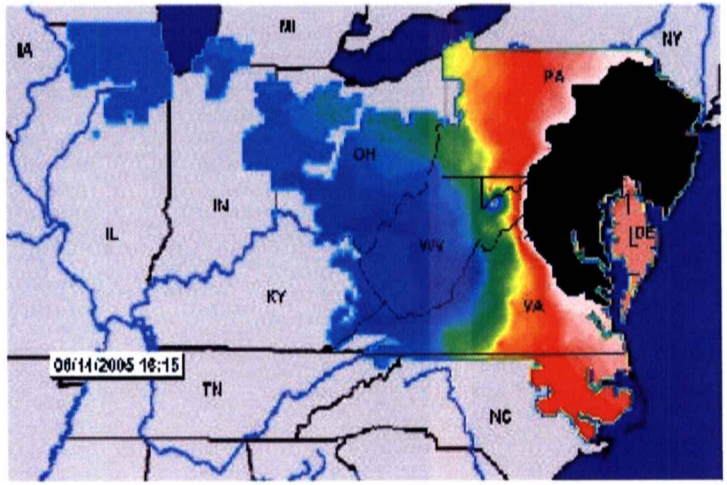

Legend | PJM RTO

Select: PJM LMP Contour Map

My eData | Constraints
Energy Contracts | Activity Log
eSuite | Announcements
IRC Report | Emergency Msgs

PJM LMP Graph
June 14, 2005 - 16:20 EDT